

उत्तर प्रदेश ग्रामीण बैंक
Uttar Pradesh Gramin Bank
(भारत सरकार, उत्तर प्रदेश सरकार एवं बैंक ऑफ बड़ौदा का संयुक्त उपक्रम)
बाराबंकी परिक्षेत्र (Barabanki Region)

ROBBK/P&E/AM/2025-26/145

Date: 18-08-2025

Dear All
Empanelled Electrical Contractors

ELECTRICAL WORK OF BRANCH IN BARABANKI REGION
(Only Empanelled Vendors of Uttar Pradesh gramin bank can quote)

Dear Sir,


Uttar Pradesh Gramin Bank Barabanki Region invites your competitive rates for Electrical work at the premises of Ranikatra Branch situated in Barabanki Region under following terms and conditions-

S.N.	Branch	Premises	Architect	Branch Contact No.
1.	Ranikatra	New	Gunjan & Associates	7388800337


TERMS AND CONDITIONS-

Please submit your rates in a closed envelope under following terms and conditions:-

1	The rates quoted should be inclusive of all type of charges & expenses. The GST will be paid extra.
2	Please quote your competitive rate on the enclosed formats.
3	If it is found that the material used is not the same as mentioned in quotation then the Bank has the right to reject the work & the material.
4	If any type of change is required in Electrical work it should be duly approved by the Regional Manager of Barabanki Region.
5	If the rates quoted by you are accepted by the Bank then the Electrical work is to be completed within 30 days from the date of work order. Please note that if the work is not completed within given time then the Bank has the right to impose the penalty of rupees 5000/- for every 07 days delay.
6	Rates quoted will be valid for 180 days from the date of opening of quotation.
7	Please note that the measurement & items are tentative & may increase or decrease as per the requirement of Bank. The variation may be up to 20% only.
8	After completion of work, it will be duly verified by the concerned Branch Manager and the Architect authorized by the bank for supervision/ verification of work.
9	Please note that the Bank will not provide any advance against the work order. The payment in full or in parts will be made only after the completion of work & verification by the Architect & Branch Manager.
10	The Bank will retain 5% cost of bill for 180 days from the date of final bill, while making the payment to cover the defect in the liability period.
11	Please note that before starting the work at the Branch, the raw material should be duly verified by the Branch Manager.
12	The quotation in closed envelope must reach the Regional Office Barabanki positively on or before 08.09.2025 till 02:00 PM.
13	Bank has the full right to accept or reject any or all tenders without any notice.
14	Please submit your competitive rates in closed envelope positively on or before 08.09.2025 till 02:00 PM at office address:- UTTAR PRADESH GRAMIN BANK, Regional office barabanki, C- 930 & 931, Civil lines, deva road, barabanki Pin - 225001. The quotations will be opened on 08.09.2025 at Regional Office, Barabanki at 04.00 PM in presence of committee members. All the empanelled vendors who have quoted the rates are requested to remain present at the time of opening of tenders. Please note that no separate notice will be given for this purpose.


Regional Manager
(Region Barabanki)

क्षेत्रीय कार्यालय: सी-930 & 931, सिविल लाईंस, देवा रोड, बाराबंकी-225001
Regional Office: C-930 & 931, Civil Lines, Deva Road, Barabanki Pin-225001
दूरभाष-7388800301, 397, 398, 399

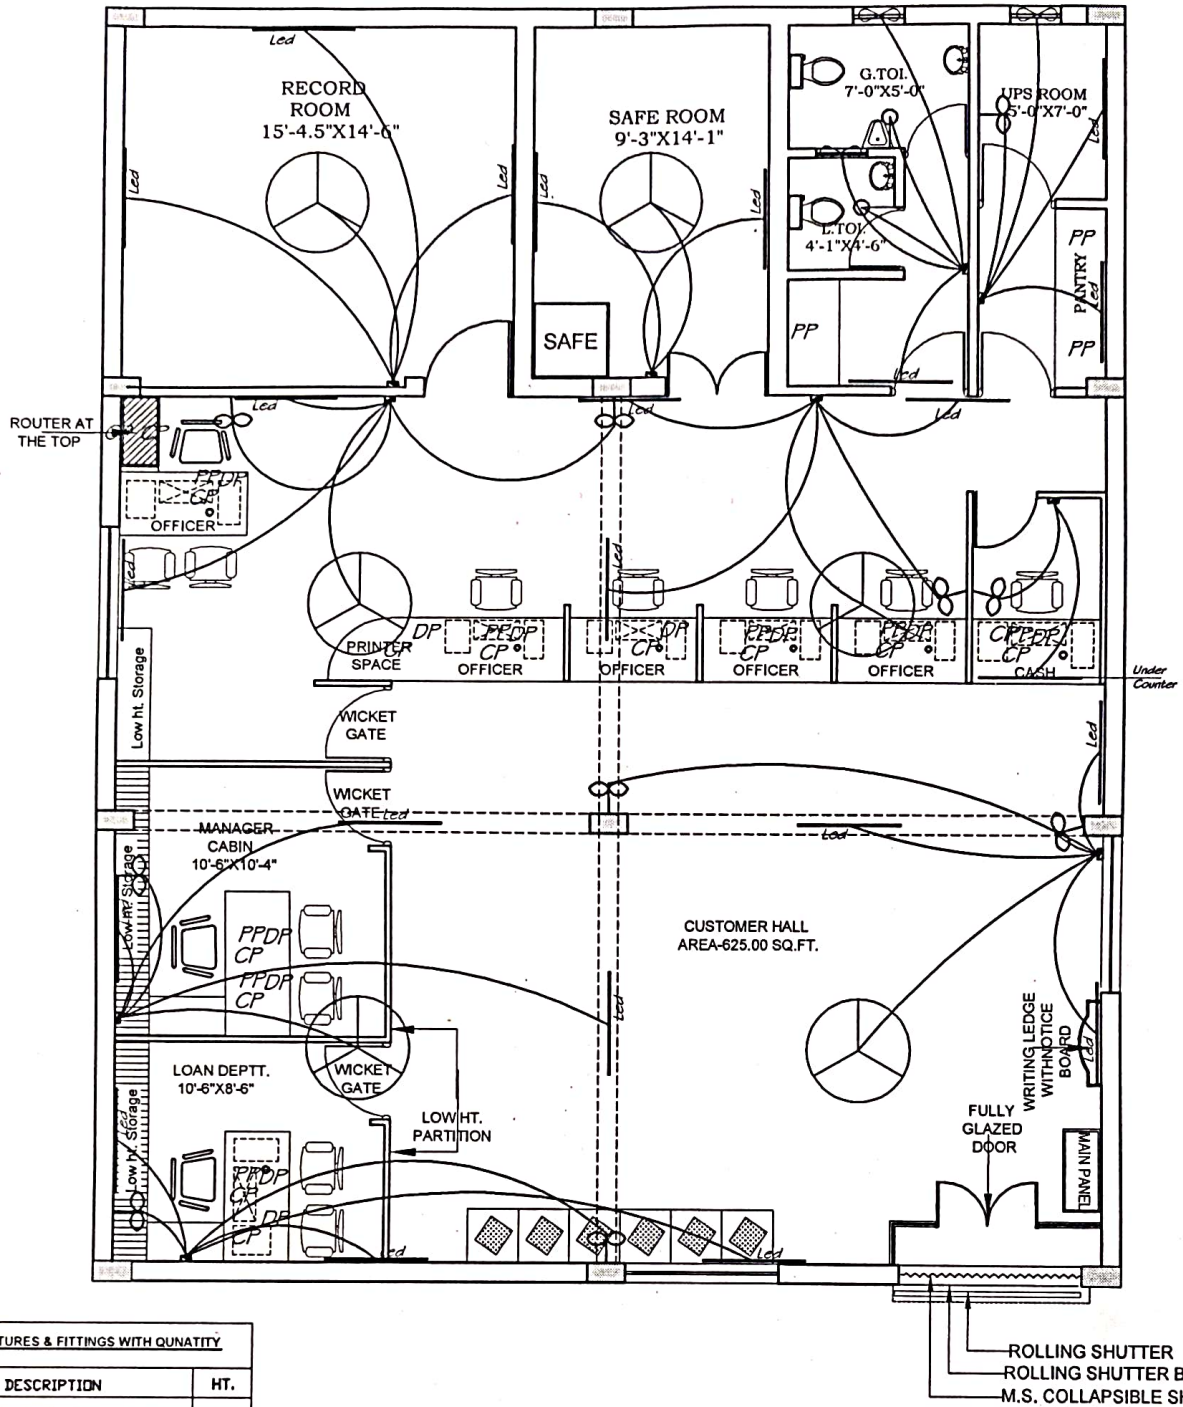

LEGENDS FOR FIXTURES & FITTINGS WITH QUNATITY

S.NO.	SYMBOL	DESCRIPTION	HT.
1.	—	4' long LED TUBE LIGHT	8'-0"
2.		CEILING FAN	
3.		Wall mounted Fan	6'-6"
4.		AFF/ EXHAUST	8'-6"
5.		LED bulb light holder	8'-6"
6.		SWITCH BOARD	4'-6"
7.	PP/CP/DP	POWER/ COMPUTER/ DATA	1'-0"
8.		MAIN LT PANEL	
9.		TPN Db	6'-0"
10.		SPN Db	6'-0"



ROLLING SHUTTER
ROLLING SHUTTER BOX
M.S. COLLAPSIBLE SHUTTER

Alternative-2

PROJECT:-

REVISED LAYOUT PLAN FOR
UTTAR PRADESH GRAMIN
BANK AT BRANCH RANI
KATRA REGIONAL OFFICE
BARABANKI.

DRG. TITLE:-

GROUND FLOOR

DATE:-

AUG-2025

NORTH:-



DRAWN BY:-

ARCHITECT:-

GUNJAN & ASSOCIATES
ARCHITECTS, ENGINEERS, INTERIOR
AND LANDSCAPE DESIGNERS.
141, SAINIK NAGAR, LANE NO-9,
RAEBARELI ROAD LUCKNOW-226002
Telephone No:- +0522-3553324
Phone No:- +9838818489, 9839018489
E-Mail:-studio@gunjanandassociates.com
Web:-www.gunjanandassociates.com

ELECTRICAL		
1.	MCCB	MDS legrands, ABB, GE, SIEMENS, as per Specification
2.	Changeover	Indo Asian/ HPL Socomec / GE/ Standard stangaurd/ as per Specification
3.	Distribution board	MDS / Standard / Indo Asian / HPL/ as per Specification
4.	MCB	MDS / Standard / Indo Asian / HPL/ as per Specification
5.	Cable	Gloster / Rallison / Incab / CCI/ as per Specification
6.	Copper wire	Rallison / Finolex / Polycab / R.R. Cable /as per Specification
7.	Switch / Socket / Call bell and accessories	Anchor / Havells / CPL / MDS / Philips / Simon/ as per Specification
8.	Electrical Light Fittings / Fixtures Complete	LED-Crompton / Panasonic
9.	Wall Fan / Ceiling Fan / Exhaust Fan	Celling Fan =Bajaj / Crompton Wall Mounted Fan= Crompton / Alstrom (Metalic Body)

NOTE: In case any make is mentioned in bill of quantity, it will take precedence over those given in the Given in the "Acceptable Makes of Materials" above.

The choice of make at a specific site will have to be consent with the project architect.





Gunjan and Associates
Architects, Engineers, Interiors
& Landscape Designers

141, Sainik Nagar, Raibareilly Road, Lucknow-226002

Phone: 0522-3553324, 9838818489

E-mail: studio@gunjanandassociates.com


URL: www.gunjanandassociates.com

BILL OF QUANTITY FOR ELECTRICAL WORKS

FOR UTTAR PRADESH GRAMIN BANK, BRANCH RANI KATRA, RO BARABANKI.

S.NO.	DESCRIPTION OF ITEM	QTY	UNIT	RATE (Rs.)	AMOUNT (Rs.)
1	SITC of 100Amp Kit kat Fuse unit 3 nos with 100 Amp neutral link on wooden board (3' x 3') complete with connections (new).	1	Set		
	ELECTRICAL PANEL				
2	ELECTRICAL DISTRIBUTION DB SITC of 6way Vertical TPN DB complete with 100Amp 16kA TPN MCCB as Incomer, 63A TP 10kA MCB -4 Nos and 6-16Amp S.Pole 10kA MCB-3 Nos as outing complete in all respects as required The job shall be completed, to the satisfaction of the Bank Engineer/Architect.	1	Set		
3	<u>Changeover</u> : S/F of 63A 4P changeover near Main Db for regulating DG supply including proper connections.	1	Each		
LOM	Changeover Switch- C&S/ Havells/ L&T/ HPL				
3	UPS I/P, O/P AND DISTRIBUTION				
a.	SITC of 40/ 32 AMP industrial socket along with DPMCB for UPS & Inverter I/P ,O/P	2	Nos.		
b	SITC of 12 WAY SPN DB Double Door (1 No. 40 AMP DP MCB and 10 NOS. 6-10 AMP SPMCB) (Branch UPS Power Distribution for UPS Points at Manager Cabin (2nos.), and Staff counters (7nos.). F&B Alarm System (2nos.) and 9U Rack (1nos.)	1	Nos.		
c	SITC of 63Amp Rotary Phase selector switch complete with RYB indication lift in incloser complete in all respects as required. (Branch UPS)	1	Nos.		
4	RAW POWER & FAN, LIGHTING DB & AC DISTRIBUTION BOARD				
a.	4 WAY TPN DB Double Door (1 No. 20 AMP TP MCB and 12 Nos. 6-10 AMP. SPMCB in each outgoing circuit for Light, Fan & 6A Socket 15A Power Points,) all complete.	1	Nos.		
5	CABLES				
a.	SITC of 4 Core 16.0 Sq.mm Aluminium Armoured Cable (From Electric Meter to Electric Panel), complete with end termination and all respect as required.	18	Mtr.		
b.	SITC of 4 x 6.0 Sq.mm Copper Wire + 1 x 4.0 Sqmm Copper Earth Wire (Panel to UPS Incomer, LDP and UPSDB) in PVC Pipe fixing on walls or chassing the walls and making it good with cement mortar of 1:5 ratio and painting compete with end termination/lugs and in all respect as required.	85	Mtr.		
c.	SITC of 2 x 6.0 Sq.mm Copper Wire + 1 x 2.5 Sqmm Copper Earth Wire (Rotary Switch to UPS and UPS to UPS DB) in PVC Pipe fixing on walls or chassing the walls and making it good with cement mortar of 1:5 ratio and painting compete with end termination/lugs and in all respect as required.	55	Mtr.		
7	EARTHING				
a.	PIP technology GEL type 50mmdia 3000mm long earth electrod. One Earthing for Neutral grounding,	2	Nos.		

b.	4 Sq.mm Copper Earth Wire from earthing pit /Earth terminal to load point (UPS DB and Main DB etc)	65	Mtr.		
8	UPS POINT				
a	Supply & Installation of point wiring for Primary UPS or stabilized power plug points on workstations / table for computers using 3 x 1.5 Sq.mm copper conductor multi strand FR PVC sheathed flexible wire pulled through floor raceways/conduit and taken upto table top using PVC rigid or flexible conduits run within wooden/metal partitions. Each point consisting of 2 nos of 10A 3 pin sockets, 1 nos 16A 2/3 pin sockets, 1 nos 16A Switch (Modular) & 1 nos indicator, wired together forming one point. The earth wire of green color only. No secondary UPS Points to be made.	14	Nos.		
9	RAW POWER POINT 16A SOCKET POINT IN WALL ONLY				
a.	Supply & Installation of point wiring for Primary Raw power plug points on walls only for computers using 2X4+1X2.5 Sq.mm copper conductor PVC sheathed flexible wire pulled through already laid floor raceways and taken upto table top using PVC rigid or flexible conduits run within wooden/metal partitions. Each point consisting of 2 nos of 16A 2/3/5 pin socket & 2 nos 16A Switch (Modular), wired together forming one point. The earth wire of green color only. No secondary Points to be made. (Only 1cash, 2B.M. 5 Officer, 1 pantry 1 d.w.)	11	Nos.		
b	Safe room controlling DP MCB - Circuit wiring with 3*1.5sq.mm FRLSH Cu stranded wires to be laid in 20 mm OD PVC medium duty laid & concealed in wall/ floor/ panelling/ partitions or above false ceiling as per requirement. The job also includes supply & fixing of 32A 2P MCB in 2way metallic box including connections with lugs. The job shall be complete & to the entire satisfaction of the Bank.	1	Job		
	PVC Insulated FRLSH Copper wire (ISI Marked)- Skyline/ Finolex/ Havells/ Polycab				
	PVC Conduit- CAP/ BEC/ Sieko/ AKG				
	MCB 10kA "C" Characteristics L&T/ Siemens/ Schnider/ Legrand				
10	LIGHT/FAN POINT				
	Supply & Installation of concealed point wiring using 600v grade 1.5 Sq.mm copper conductor PVC insulated wires (with proper R,Y,B color code) pulled through heavy gauge PVC conduits laid concealed over false ceiling including 2 Nos. 2.5 sqmm circuit wires from the relevant DB and also including 2.5 sqmm green color copper earth wire and switch plate, switches, etc. as approved by the Bank's Engineer/Architect.				
a.	Primary light points including the cost of 10 A modular switch	25	Nos.		
c.	Ceiling Fan Point including the cost of 10A modular Switch along with 4/5 step electronic fan regulator.	6	Nos.		
d.	Wall Fan Point along with 10 AMP modular switch	10	Nos.		
e.	Exhaust Fan Point along with 10 AMP modular switch	3	Nos.		
f.	6/10A Switch with 5pin 10A socket in counter, light & fan board	6	Nos.		
11	DATA CABLING & POINT THERE MUST BE MINIMUM 3FEET DISTANCE BETWEEN DATA AND				
	Supplying and laying of D-Link make CAT-6 (UTP) cable through trenches / conduits.				
a.	Supplying and laying D-link make CAT-6 Cable complete with CAT-6 information outlet with plate & surface Box at individual Tables	10	Nos.		
b.	Supplying and fixing of 2 mtr long crimped patch cord	10	Nos.		
c	S/F of 24 Port Patch Panel complete in all respects	1	Each		
	Patch Panel- Brocade/ Cisco/ DigiLink/ 3 Com/ Nortel/ Foundry/ D- Link				



d	Supply & Fixing of wall mounted rack 9U with glass perforated front door and removable rear locking door, Mounting Hardware pack, Fan assembly - Cable entry from rear complete in all respects	1	Each		
	Racks- Com Rack/ HCL/ Val Rack/ APW President				
13	FIXTURES				
	SITC of following fixtures as per make list				
a	LED Tube Light Patti Type (white) - 20 Watts Make/ Brand as per MAKE LIST	23	Nos.		
e	LED Bulb with holder (white) - 9 Watts	2	Nos.		
	TOTAL (excl. GST) (Rs.)				

Note: All rates are excluding G.S.T.

For GUNJAN & ASSOCIATES

Gunjan Kapur
(Ar. GUNJAN KAPUR)
PROPRIETOR

Ar. Gunjan Kapur

For M/s Gunjan & Associates

